PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT

GENERAL NOTES:
- DO NOT ALLOW TUBING TO COME IN CONTACT WITH THE FOLLOWING ELEMENTS
  - PIPE THREAD SEALING COMPOUNDS
  - FIRE WALL PENETRATION COMPOUNDS
  - PETROLEUM BASED MATERIALS
- KEEP TUBING A MINIMUM OF 12-INCHES VERTICALLY OR 6-INCHES HORIZONTALLY FROM SOURCES OF HIGH HEAT
- ANCHOR HOSE BIBS TO PREVENT STRAIN ON PEX TUBING
- DO NOT BEND PEX TUBING TIGHTER THAN A 5-INCH RADIUS FOR 1/2-INCH TUBE, AND TIGHTER THAN A RADIUS OF 7-INCHES FOR 3/4-INCH TUBE
- TUBING SHALL BE STORED UNDER COVER AND OUT OF DIRECT SUNLIGHT
- INSULATE HOT WATER TO A MINIMUM OF R-4
- PLASTIC HANGERS AND STRAPS ARE RECOMMENDED
- SUPPORT HORIZONTAL TUBING EVERY 32-INCHES, AND VERTICAL TUBING EVERY 8-FEET TO 10-FEET, AND AT MID-POINT BETWEEN FLOORS
- DO NOT PULL TUBING TIGHT DURING INSTALLATION
- ALLOW 1/8-INCH SLACK PER FOOT OF INSTALLED TUBING
- INSTALL PERMANENT ROOF ANCHOR FALL SAFETY SYSTEM

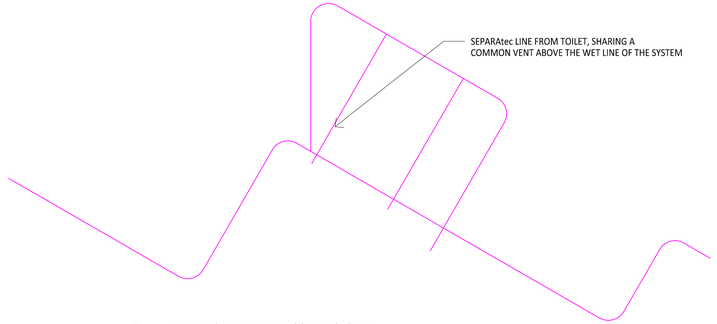

FUTURE GREY WATER RECOVERY SYSTEM
N.T.S.

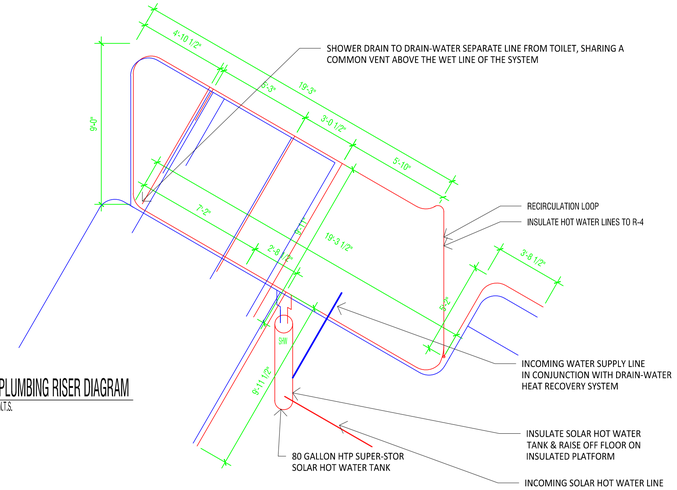

PLUMBING RISER DIAGRAM
N.T.S.

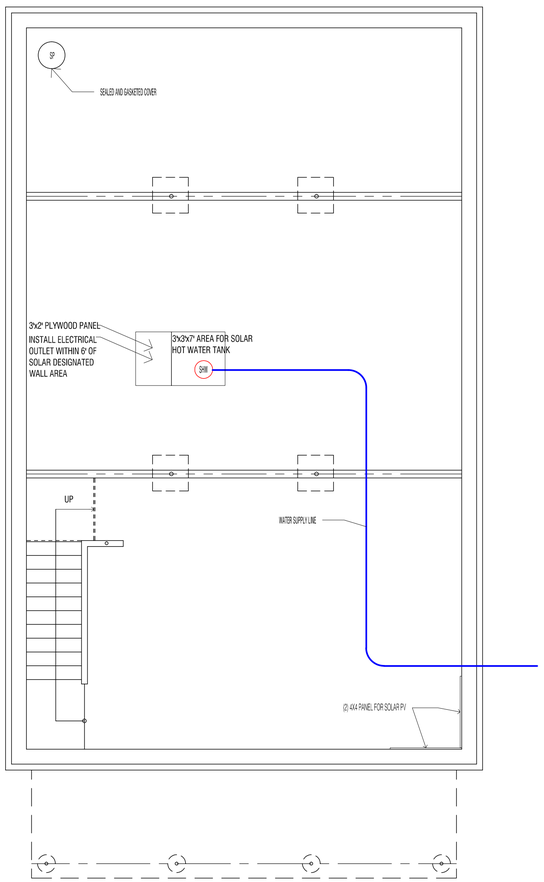

3 M-500 BASEMENT PLAN PLUMBING
SCALE: 1/4" = 1'-0"

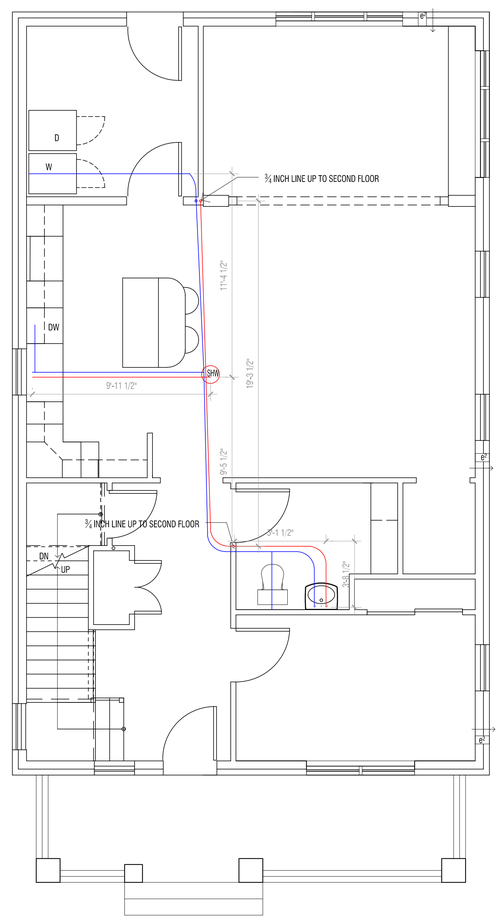

1 M-500 1ST FLOOR PLAN PLUMBING
SCALE: 1/4" = 1'-0"

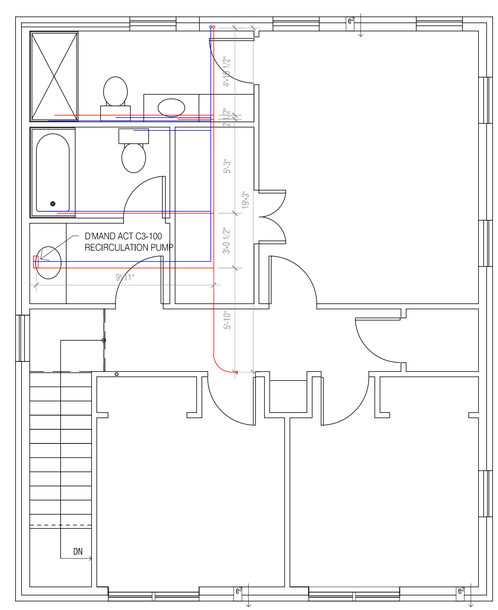

2 M-500 2ND FLOOR PLAN PLUMBING
SCALE: 1/4" = 1'-0"

MONTAGE BUILDERS NORTHERN FOREST

- College of Environmental Science and Forestry
- Syracuse University
- Onondaga Community College

www.montagebuilders.com

REVISIONS

NO.	DATE	BY	DESCRIPTION
1	30MAR2014	DAW	FINAL REVIEW

PROJECT ADDRESS
201 HUBBELL AVE.
SYRACUSE, NY 13207

DESIGNATION
PLUMBING PLANS

PROJECT NAME
THE MONTAGE

SCALE
AS NOTED

DATE
MARCH 30, 2014

DRAWING NO.
P-500

PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT
PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT
PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT